

	<b>Details</b>
<b>Applicant</b>	ESP Water Limited (“ <b>ESP Water</b> ”)
<b>Site Details</b>	Station Road, Newport, Shropshire, TF10 9LL (“ <b>the Site</b> ”)
<b>Services</b>	Water and Sewerage
<b>Current water and sewerage appointee</b>	Severn Trent Water Limited (“ <b>Severn Trent Water</b> ”)
<b>Proposed supply arrangements</b>	Bulk supply and discharge agreement with Severn Trent Water
<b>Criterion</b>	Unserved
<b>Household Customer</b>	301
<b>Business Customers</b>	0
<b>Developer</b>	Bloor Homes Limited
<b>Estimated Site completion date</b>	1 January 2027
<b>Summary of consultation</b>	A statutory consultation made under section 8(3) of the Water Industry Act 1991 (“ <b>WIA91</b> ”) to grant ESP Water a variation to its appointment as a water and sewerage company. To also vary the appointment of Severn Trent Water as a water and sewerage company. Consequently, ESP Water will become the water and sewerage company for the Site.
<b>Deadline for submissions</b>	<p>Representations or objections to this consultation should be sent by email to <a href="mailto:Licensing@ofwat.gov.uk">Licensing@ofwat.gov.uk</a> or in writing and sent to the NAV licensing team, Centre City Tower, 7 Hill Street, Birmingham, B5 4UA.</p> <p>Reponses must be received by Ofwat no later than <b>17.00</b> hours on <b>21 November 2022</b>.</p>
<p>Further information about how to make representations or objections, including information on the treatment of confidential information, can be obtained from Ofwat at the above address or at <a href="http://www.ofwat.gov.uk/foi/">http://www.ofwat.gov.uk/foi/</a>.</p> <p>Ofwat will only use the information you have provided for the purpose of this consultation. We will retain your information in accordance with Ofwat’s retention schedule and will not share with third parties unless we have a legal obligation to do so. For further information please see Ofwat’s Privacy Policy in our <a href="#">Publication Scheme</a>.</p>	

## 1. ESP Water

ESP Water was set up in April 2021 by ESP Utilities Group ("**ESP Utilities**") to operate in the NAV market. ESP Water is a wholly owned subsidiary of ESP Utilities. ESP Utilities owns companies that operate in other utility markets, such as gas and electricity, with over 650,000 customers connected on a variety of networks.

ESP Water intends to operate as an undertaker providing water and sewerage services to household customers. ESP Water will offer water only or water and sewerage services to household customers, as part of a multi utility offering. ESP Water will enter into bulk supply and discharge agreements with incumbent companies and does not plan to use its own resources. ESP Water does not have any acquisition plans; it plans to grow organically via its existing contacts. Self-Lay Providers ("**SLPs**") will construct the networks on site and ESP Water will not undertake installation work but will acquire completed connections.

ESP Water has not previously operated in the sector, and ESP's first application was for a site in United Utilities Water Limited's area, Merchant's Wharf - the consultation document for this site can be viewed [here](#). We granted ESP Water its appointment on 26 July 2022 for this site.

ESP Water has applied to provide water and sewerage or water only services to ten other sites. We are currently processing the assessment for each site, and we will consult on these accordingly.

## 2. The proposal

Ofwat proposes to:

- vary the appointment of ESP Water as a water and sewerage company, by including the Site in its water supply area and sewerage services area: and
- vary the appointment of Severn Trent Water as a water and sewerage company by excluding the Site from its water supply area and sewerage services area.

By means of the above, if we grant the variation to ESP Water, it will become the water and sewerage services provider for the Site.

ESP Water has notified Ofwat, the Market Operator for the business retail market in England ("**MOSL**") and the Department for Food, the Environment and Rural Affairs ("**Defra**"), of its intention to exit the business retail market. ESP Water intends to operate as a wholesaler and retailer for household customers and wholesaler for business customers.

As such, ESP Water has entered into a subcontracted arrangement with Castle Water Limited ("**Castle Water**"), whereby Castle Water will serve its business customers until it exits the market. ESP does not propose to serve any business customers on the Site.

ESP Water [applied to Defra](#)<sup>1</sup> to exit the business retail market on 23 September 2022 and has proposed an exit date of 23 February 2023. ESP Water intends to operate as a wholesaler and retailer for household customers and wholesaler for business customers.

## 3. Our assessment of this application

### Our approach

The new appointment and variation mechanism set out in primary legislation<sup>2</sup>, provides an opportunity for entry and expansion into the water and sewerage sectors by allowing one company to replace the existing appointee as the provider of water and / or sewerage services for a specific area. This mechanism can be used by new companies to enter the market and by existing appointees to expand their businesses.

You can find further details of our approach to assessing applications for New Appointments and Variations ("**NAVs**") [here](#).

### The unserved status of the Site

To qualify under the unserved criterion, an applicant must show that at the time the appointment is made, none of the premises in the proposed area of appointment is served by the existing appointee.

Severn Trent Water has provided a letter dated, dated 7 February 2022, confirming that in its view, the Site is unserved. The Site is greenfield and aerial maps show that there are no existing buildings within the Site boundary.

Given the information provided by ESP Water and Severn Trent Water, we are satisfied that the Site may be considered unserved.

---

<sup>1</sup> Applications to exit the business retail market are processed by Defra. The Secretary of State, in accordance with regulation 11 of the Water and Sewerage Undertakers (Exit from Non-household Retail Market) Regulations 2016, grants permission for an undertaker to exit from the business retail market.

<sup>2</sup> The legal framework for new appointments is set out in the WIA91. Section 7 of the WIA91 sets out the criteria by which an appointment or variation may be made. Section 8 sets out the procedure for making that appointment or variation.

## Price

ESP Water proposes to match the charges to customers on the Site to those of Severn Trent Water, it will not offer a discount.

## Levels of service

Every appointee is required under its licence conditions to publish and make available the Core Customer Information for its household customers. We have assessed ESP Water's proposed Customer Code of Practice, and our view is that it is of an appropriate standard. Our view is that customers on the Site would be no worse off in relation to the scope of ESP Water's proposed Customer Code of Practice than they would be if Severn Trent Water were to be the customers' water and sewerage company.

## Stakeholder engagement

We take the view of the Environment Agency<sup>3</sup>, the Drinking Water Inspectorate ("**DWI**"), and the Consumer Council for Water ("**CCW**") into account before progressing to formal consultation on an application. The Environment Agency, the Consumer Council for Water and the DWI informed us that they are content for us to consult on this application.

Prior to giving its consent the Environment Agency asked that ESP Water note its comments, relating to annual forecast of non-household properties and the impact of the Site on Severn Trent Water's receiving network. It raised a query on details of innovative or water efficiency measures on the Site, and asked for ESP to confirm when it will publish its Water Resource Management Plan and Drought Plan and how ESP will engage with local plans, particularly if there are any existing or planned water cycle studies. ESP engaged directly with the Environment Agency responding to its queries and provided the additional information required.

## Impact on existing customers

In considering whether customers will be no worse off, we also considered the potential effects of this variation on the prices that Severn Trent Water's existing customer base may face. The calculation necessarily depends on a range of assumptions, and there are clearly difficulties involved in quantifying the effect. It is therefore necessary to use a simplified set

---

<sup>3</sup> The Environment Agency as well as the Drinking Water Inspectorate will also be formally consulted on the proposals, as they are on the list of organisations which must be formally consulted as set out in section 8(4)(b) of WIA91.

of figures. We have expressed the effect in 'per bill' terms to try to quantify the possible effect in an easily understandable way.

We have assessed the potential magnitude of this impact by comparing how much Severn Trent Water might have expected to receive in revenue from serving the Site directly, were it to serve the Site, with the revenues it might expect from the proposed arrangement with ESP Water.

We estimate no annual increase on the water and sewerage bills of existing Severn Trent Water customers if we grant this variation to Icosa Water. This is once the Site is fully built out.

This estimate does not take into account the potential spill-over benefits to customers arising from dynamic efficiencies achieved as a result of the competitive process to win sites.

Therefore, we consider that granting this variation to Icosa Water would have no financial impact on customers' bills and could have potential benefits for customers.

## **Ability to finance and properly carry out its functions**

We have a statutory duty to ensure that efficient appointees can finance the proper carrying out of their functions. When a company applies for a new appointment or variation, it must satisfy us that it is able to carry out all of the duties and obligations associated with being an appointed water or sewerage company. We specifically look at the operational and financial viability of the company.

Our assessment of operational viability requires the company to demonstrate to us that it is technically and operationally able to fulfil the duties of an undertaker. The key considerations we look at are listed in our published guidance [here](#), in section 5.7 (page 40).

In carrying out our assessment of this application we have noted that ESP Water intends to use subcontracted arrangements to operate its sites; Ofwat has considered whether this could impact on ESP Water's ability to perform its functions. ESP Water has provided sufficient evidence to demonstrate that it has the necessary processes and expertise in place to be able to comply with its obligations as a water and sewerage undertaker. ESP Water has entered into a subcontracted arrangement with Castle Water Limited ("**Castle Water**"), whereby Castle Water will serve its business customers until it exits the market. We have reviewed ESP Water's intended arrangement with Castle Water and found that this interim arrangement will not impact ESP's business customers. ESP does not envisage there being any business customers on this Site.

In addition to its arrangement with Castle Water for business customers, ESP Water has several other subcontracted arrangements in place with other water and sewerage companies and third-party providers. ESP Water intends to rely on these arrangements to be able to perform its statutory and regulatory duties. These arrangements cover provisions such as emergency mains repairs and the supply of bottled water. ESP Water has provided us with information on its assessment process for appointing subcontractors, how the arrangement will work in practice and the contingency plans it has in place should these arrangements not work as intended. ESP Water has also provided details of the assurance processes it has in place to ensure any infrastructure or assets it adopts meets the industry standard required.

Having reviewed the above, we are satisfied that ESP Water has the necessary operational capacity to perform the duties of an undertaker. On balance we note that subcontracted arrangements are common amongst other NAV companies, and this in itself does not necessarily indicate ESP Water would be unable to perform its functions. If any issues were to arise with subcontractors, we expect ESP Water to have mitigations in place to eliminate or minimise any impact on customers.

We also have considered the financial position of ESP Water in relation to providing water and sewerage services to the Site, and we are satisfied the company demonstrates sufficient financial viability.

ESP Water has an unlimited Keepwell Agreement with its parent company, ESP Utilities Group. ESP Water has confirmed that this arrangement will cover this proposed new site. ESP Utilities holds an investment grade credit rating with Moody's.

On this basis, we are currently satisfied that ESP Water would be able to finance its functions if this variation is granted. We have also noted that ESP Water intends to grow quickly as a business, and we will continue to monitor its arrangements for financial security as it grows.

## **Risks identified in our assessment**

In carrying out our assessment of this application we have noted that ESP Water intends to use subcontracted arrangements to operate its sites. As indicated above, Ofwat has considered whether this could impact on ESP Water's ability to perform its functions and is satisfied with the assurances provided by ESP Water.

## 4. Conclusion and next steps


In assessing ESP Water's application, we have considered the general benefits of new appointments and variations. Our view is that our two key policy principles would be met in this case, as customers would be no worse off, and ESP Water would be able to finance, and carry out, its functions. We have also considered the effects of granting the proposed variation on the existing customers of Severn Trent Water.

We are currently minded to grant the variation under the unserved criterion. Subject to considering any representations submitted during the consultation period in response to this consultation notice, Ofwat will decide whether or not to grant the variation of appointment set out above.



## 5. Site maps

### Water

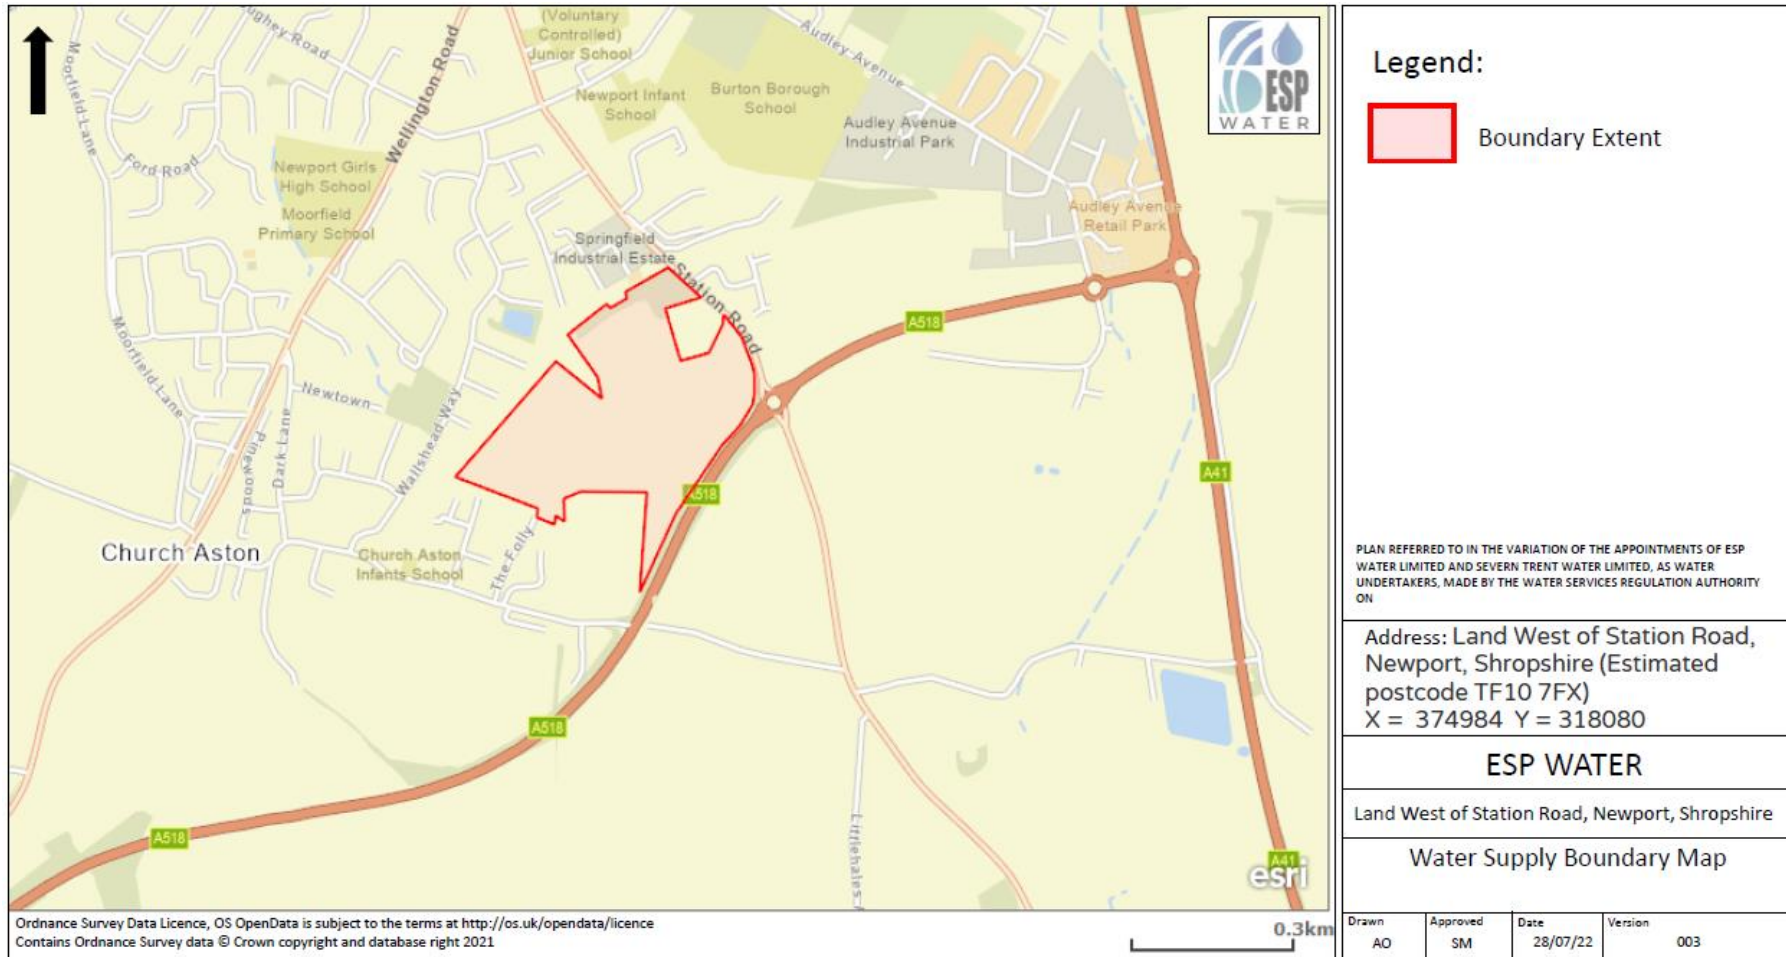



## Sewerage

